





COMMON ELECTRICAL DISTRIBUTION SYSTEMS

120/208 Volt Three-Phase Four-Wire System (WYE Connected)

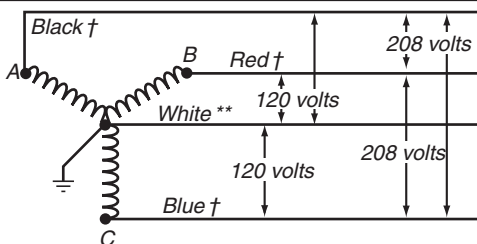

- † • A phase ungrounded conductor colored **Black**.
- † • B phase ungrounded conductor colored **Red**.
- † • C phase ungrounded conductor colored **Blue**.
- ** • Grounded neutral conductor colored **White** or **Gray**.

277/480 Volt Three-Phase Four-Wire System (WYE Connected)

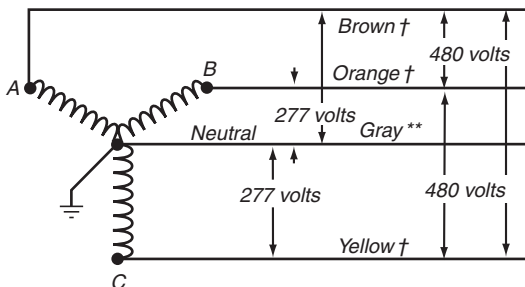

- † • A phase ungrounded conductor colored **Brown**.
- † • B phase ungrounded conductor colored **Orange**.
- † • C phase ungrounded conductor colored **Yellow**.
- ** • Grounded neutral conductor colored **Gray**.

** Grounded conductors are required to be white or gray or three white stripes. See NEC 200.6A.

† B phase of high leg delta must be Orange or tagged.

† Ungrounded conductor colors may be other than shown; see local ordinances or specifications.